

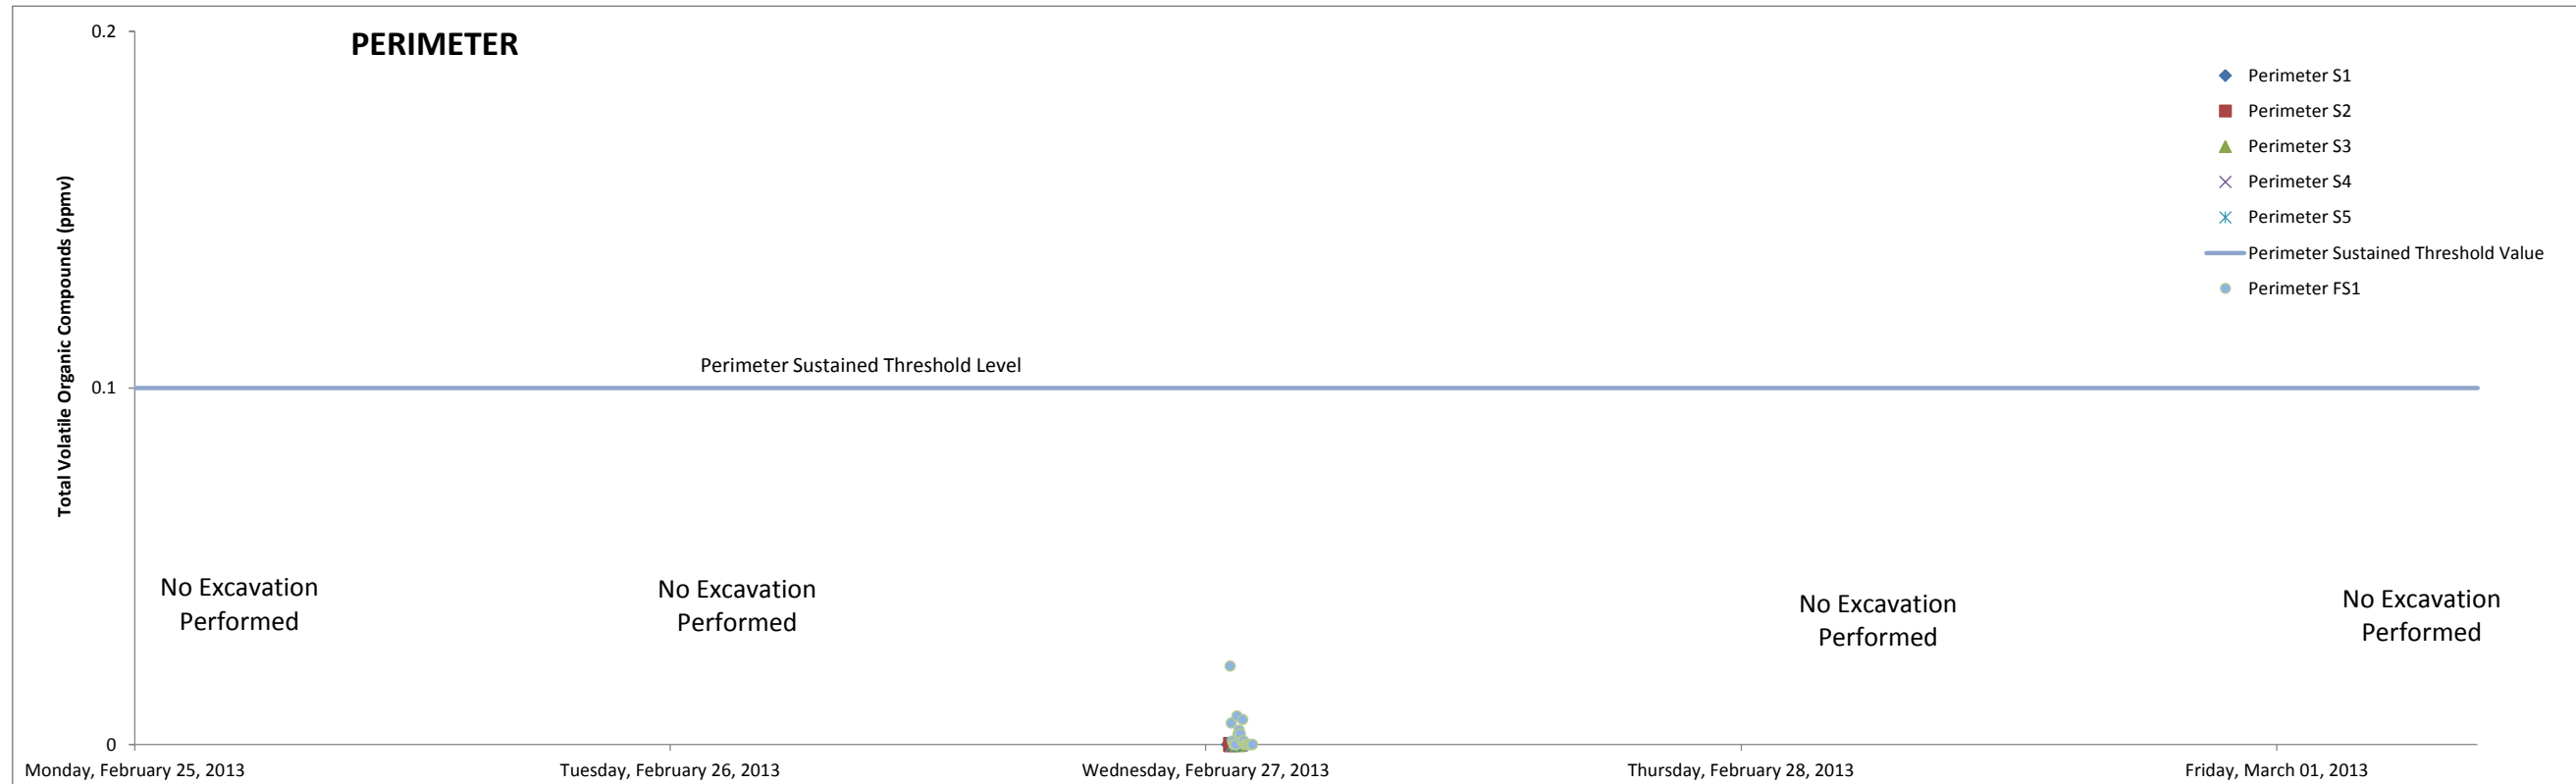
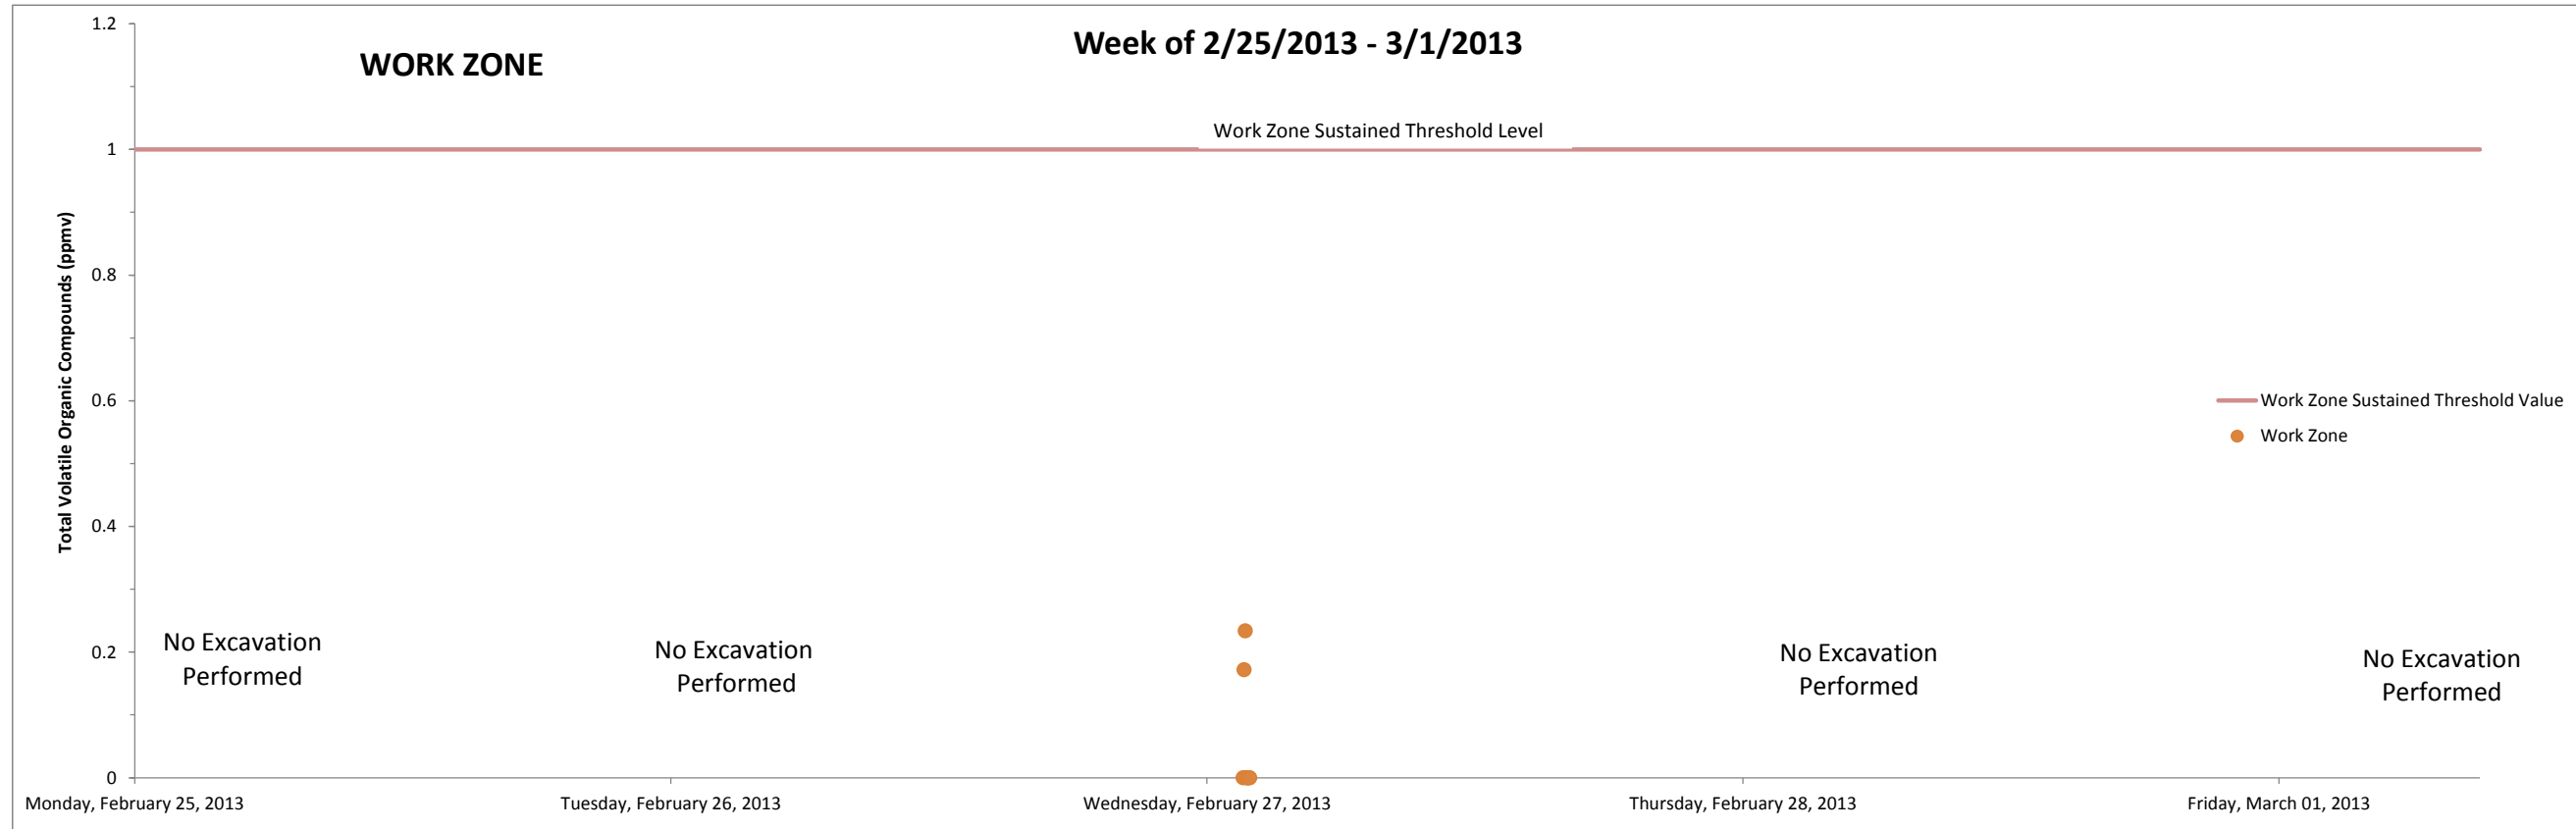


Prepared by National Grid for the Businesses and Residents Located Near the Former Tidewater Facility in Pawtucket, RI  
 Air Quality Monitoring - Total Volatile Organic Compounds (TVOCs)

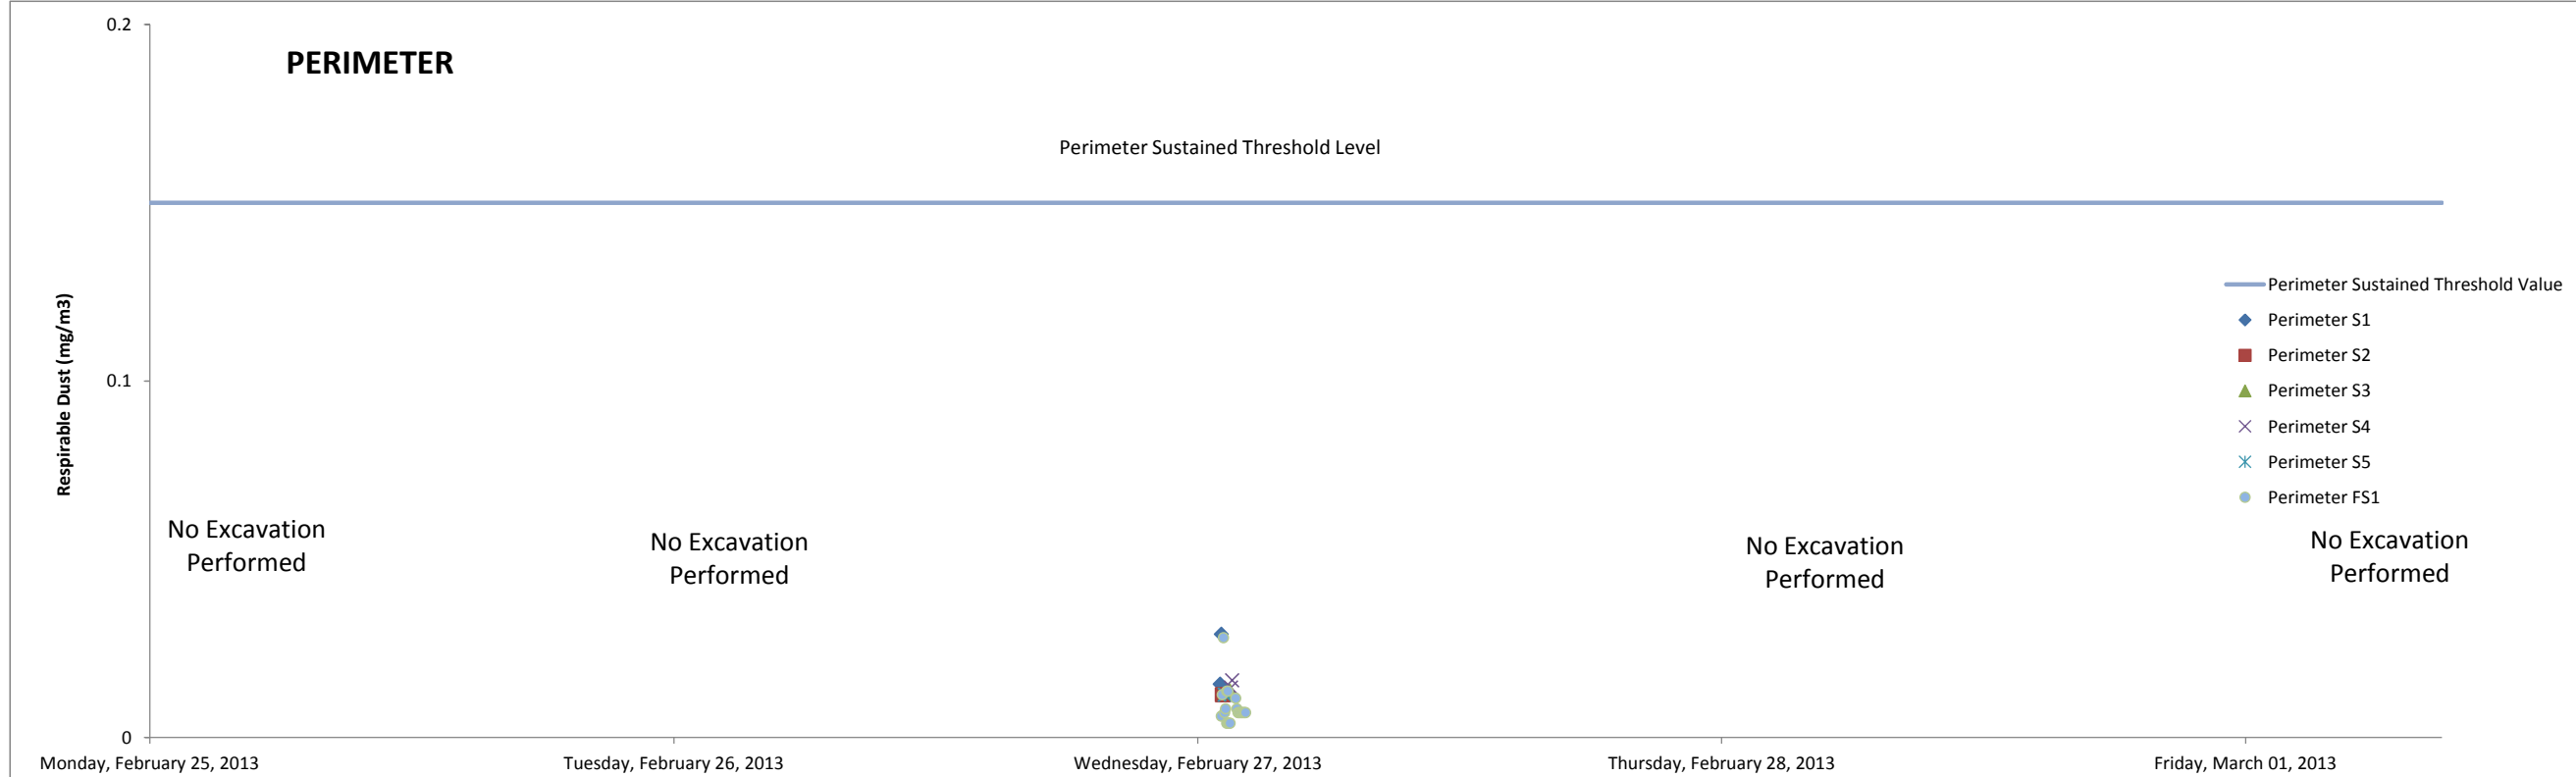

Transient readings were conducted over a three minute time period. A reading is sustained if it is held for over a five minute time period.

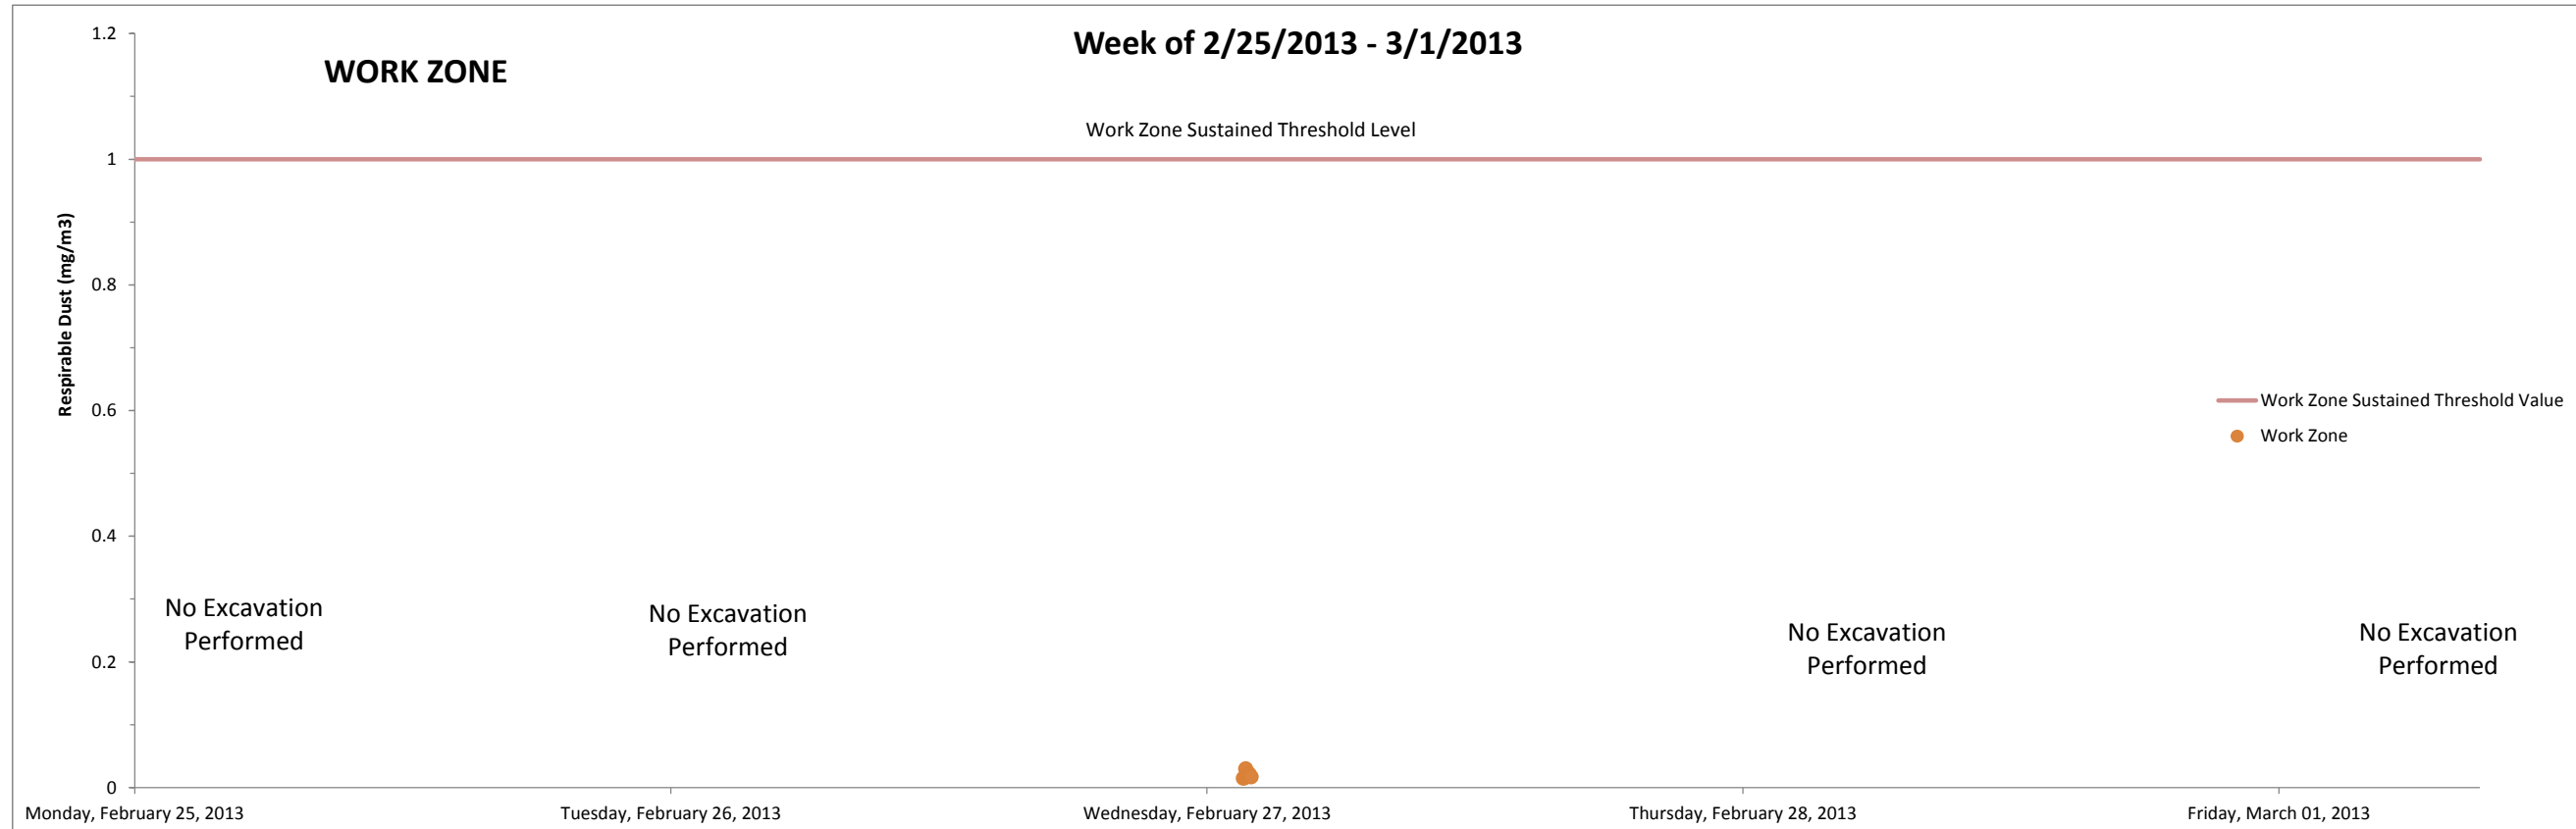

Transient readings were conducted over a three minute time period. A reading is sustained if it is held for over a five minute time period.

**Prepared by National Grid for the Businesses and Residents  
 Located Near the Former Tidewater Facility in Pawtucket, RI  
 Air Quality Monitoring - Transient Observations**

Date	Time	Location	Constituent	Observed Range of Elevated Transient Readings	Observed Conditions that may be leading to elevated transient readings
No elevated transient readings were observed during this week.					

Transient readings were conducted over a three minute time period. A reading is sustained if it is held for over a five minute time period.